



1 (1) Sida/
Page
Information Beteckning/
Designation
2018-01-30 Datum/
Date
SSG Upprättat av/
Issued by

Viktig information

Vi har uppdaterat den visuella utformningen på denna standard för att harmonisera med vår grafiska profil.

Utgåvans nummer har inte ändrats och innehållet är detsamma som tidigare med reservation för korrigeringar av eventuella stavfel. Standarden har ny logotyp och nytt typsnitt.

Important information

The visual design is updated for this standard to harmonize with our graphical profile.

The edition number has not been changed and the content is the same as before with reservations for any spelling corrections. This standard has a new logo and new font.






STANDARD SOLUTIONS GROUP

SSG 5253E

Control tuning

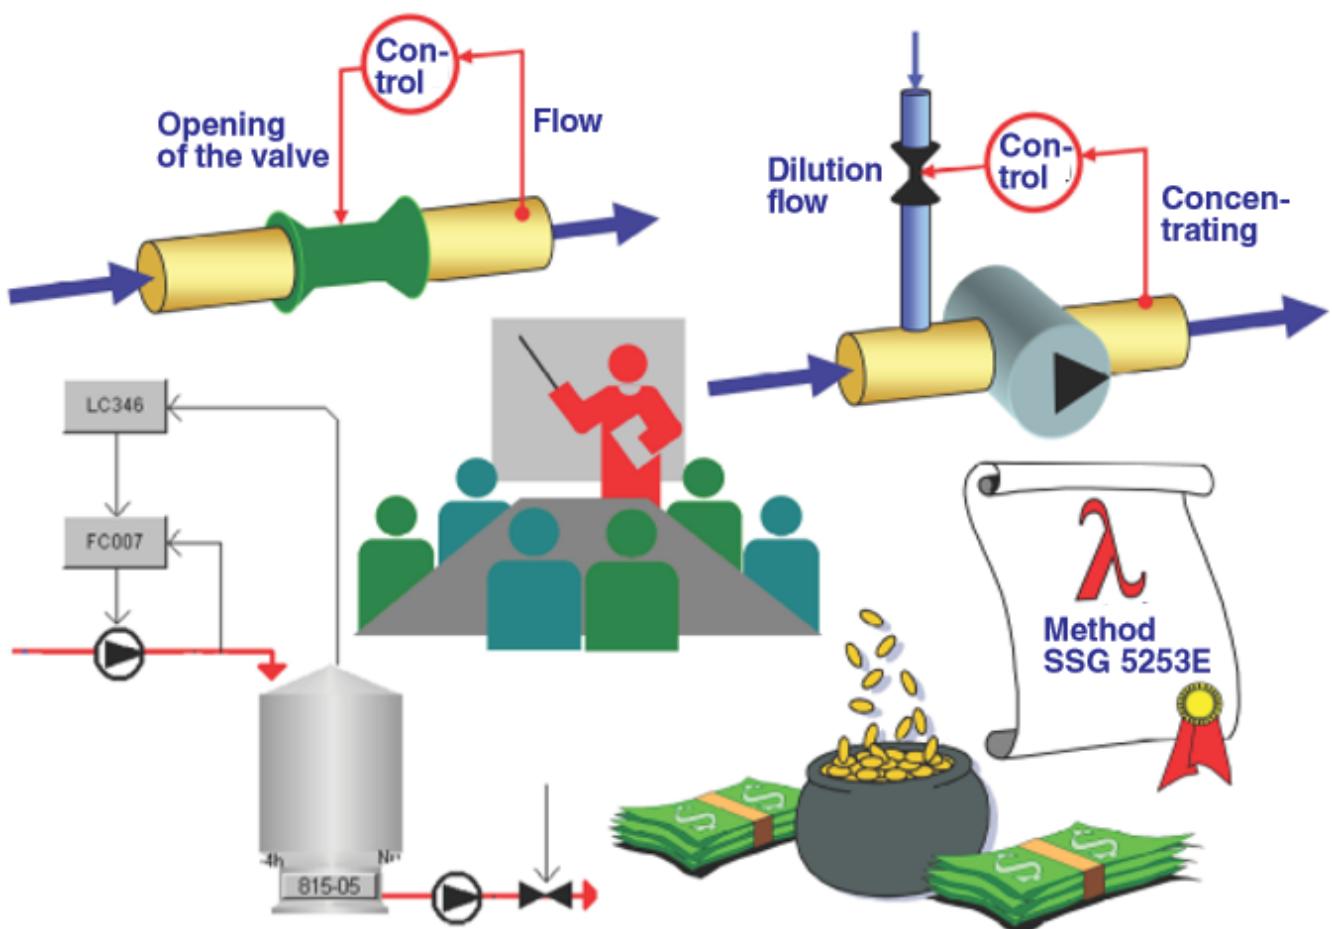

Not to be reprinted without permission



STANDARD SOLUTIONS GROUP

SSG 5253E

Date
2004-11-01

Edition
3

Designation
TKI

Page
1 (44)

Control tuning

Information within brackets [...] in this document refers to local regulations.

General

This edition differs from edition 2 mainly as a result of the development which has taken place in the field and the experience from the application of the previous edition.

These instructions give advice and guidelines for planning, performance and monitoring in conjunction with the tuning of control equipment. The instructions make no claim to be complete or exhaustive, but are nevertheless considered to provide a valuable tool for control engineers.

When a control loop or control loops are optimized, a check should at all times be made to ensure that conditions are right and that they can be achieved. Owing to changes in the process, modifications, etc, conditions may have radically altered since the control loop was originally implemented. It is also possible that the loop has never worked in the intended manner.

It is very likely that many sections of the process require better control solutions. Relocation of valves or transmitters may in some cases be necessary. It is also possible that the process must be controlled by another process variable. Improvements/modifications to the control strategy can in most cases also be effected easily in process sections equipped with control systems.

Contents

1	Introduction	3
2	The Lambda method (I)	4
3	Definitions etc	5
4	Process - process parameters	6
4.1	Self regulating process	6
4.1.1	Process gain	6
4.1.2	Process dead time	7
4.1.3	Dead time for process with several time constants	7
4.1.4	Process time constant	8
4.1.5	Process with several time constants	8
4.2	Integrating process	9
4.2.1	Velocity gain	9
4.2.2	Process time constant	10
4.2.3	Process dead time	10
5	Transmitters	11
5.1	General	11
5.1.1	Checks	11
5.1.2	Action	11
6	Sampling time (time between two executions)	11
7	Filter	13
8	Final control element	15
8.1	General	15
8.1.1	Checks	16
8.1.2	Action	17
9	Non-linearity	18
9.1	General	18
9.1.1	Checks	18
9.1.2	Static non-linearity	18
9.1.3	Dynamic non-linearity	18
10	PID controller block and structure	19
10.1	P block	20
10.1.1	P control	20
10.2	I block	21
10.2.1	PI control	21
10.3	D block	22
10.3.1	PID control	23
11	Controller tuning	23
11.1	General	23
11.2	Step response, self regulating process	24
11.2.1	Step response analyses, self regulating process	24
11.2.2	Calculation of control parameters	25
11.3	Step response, integrating process	29
11.3.1	Step response analysis, integrating process	30
11.3.2	Calculation of control parameters	30
12	Monitoring	37
13	Automatic control engineering solutions	37
14	Fieldbus applications	43
15	References	44
Appendix 1: - "Tuning sheet for self regulating processes with Lambda method Example"		
Appendix 2: - "Tuning data for self regulating processes with Lambda method Example"		